


Anlage 03 zur Vorlage VO/0966/12

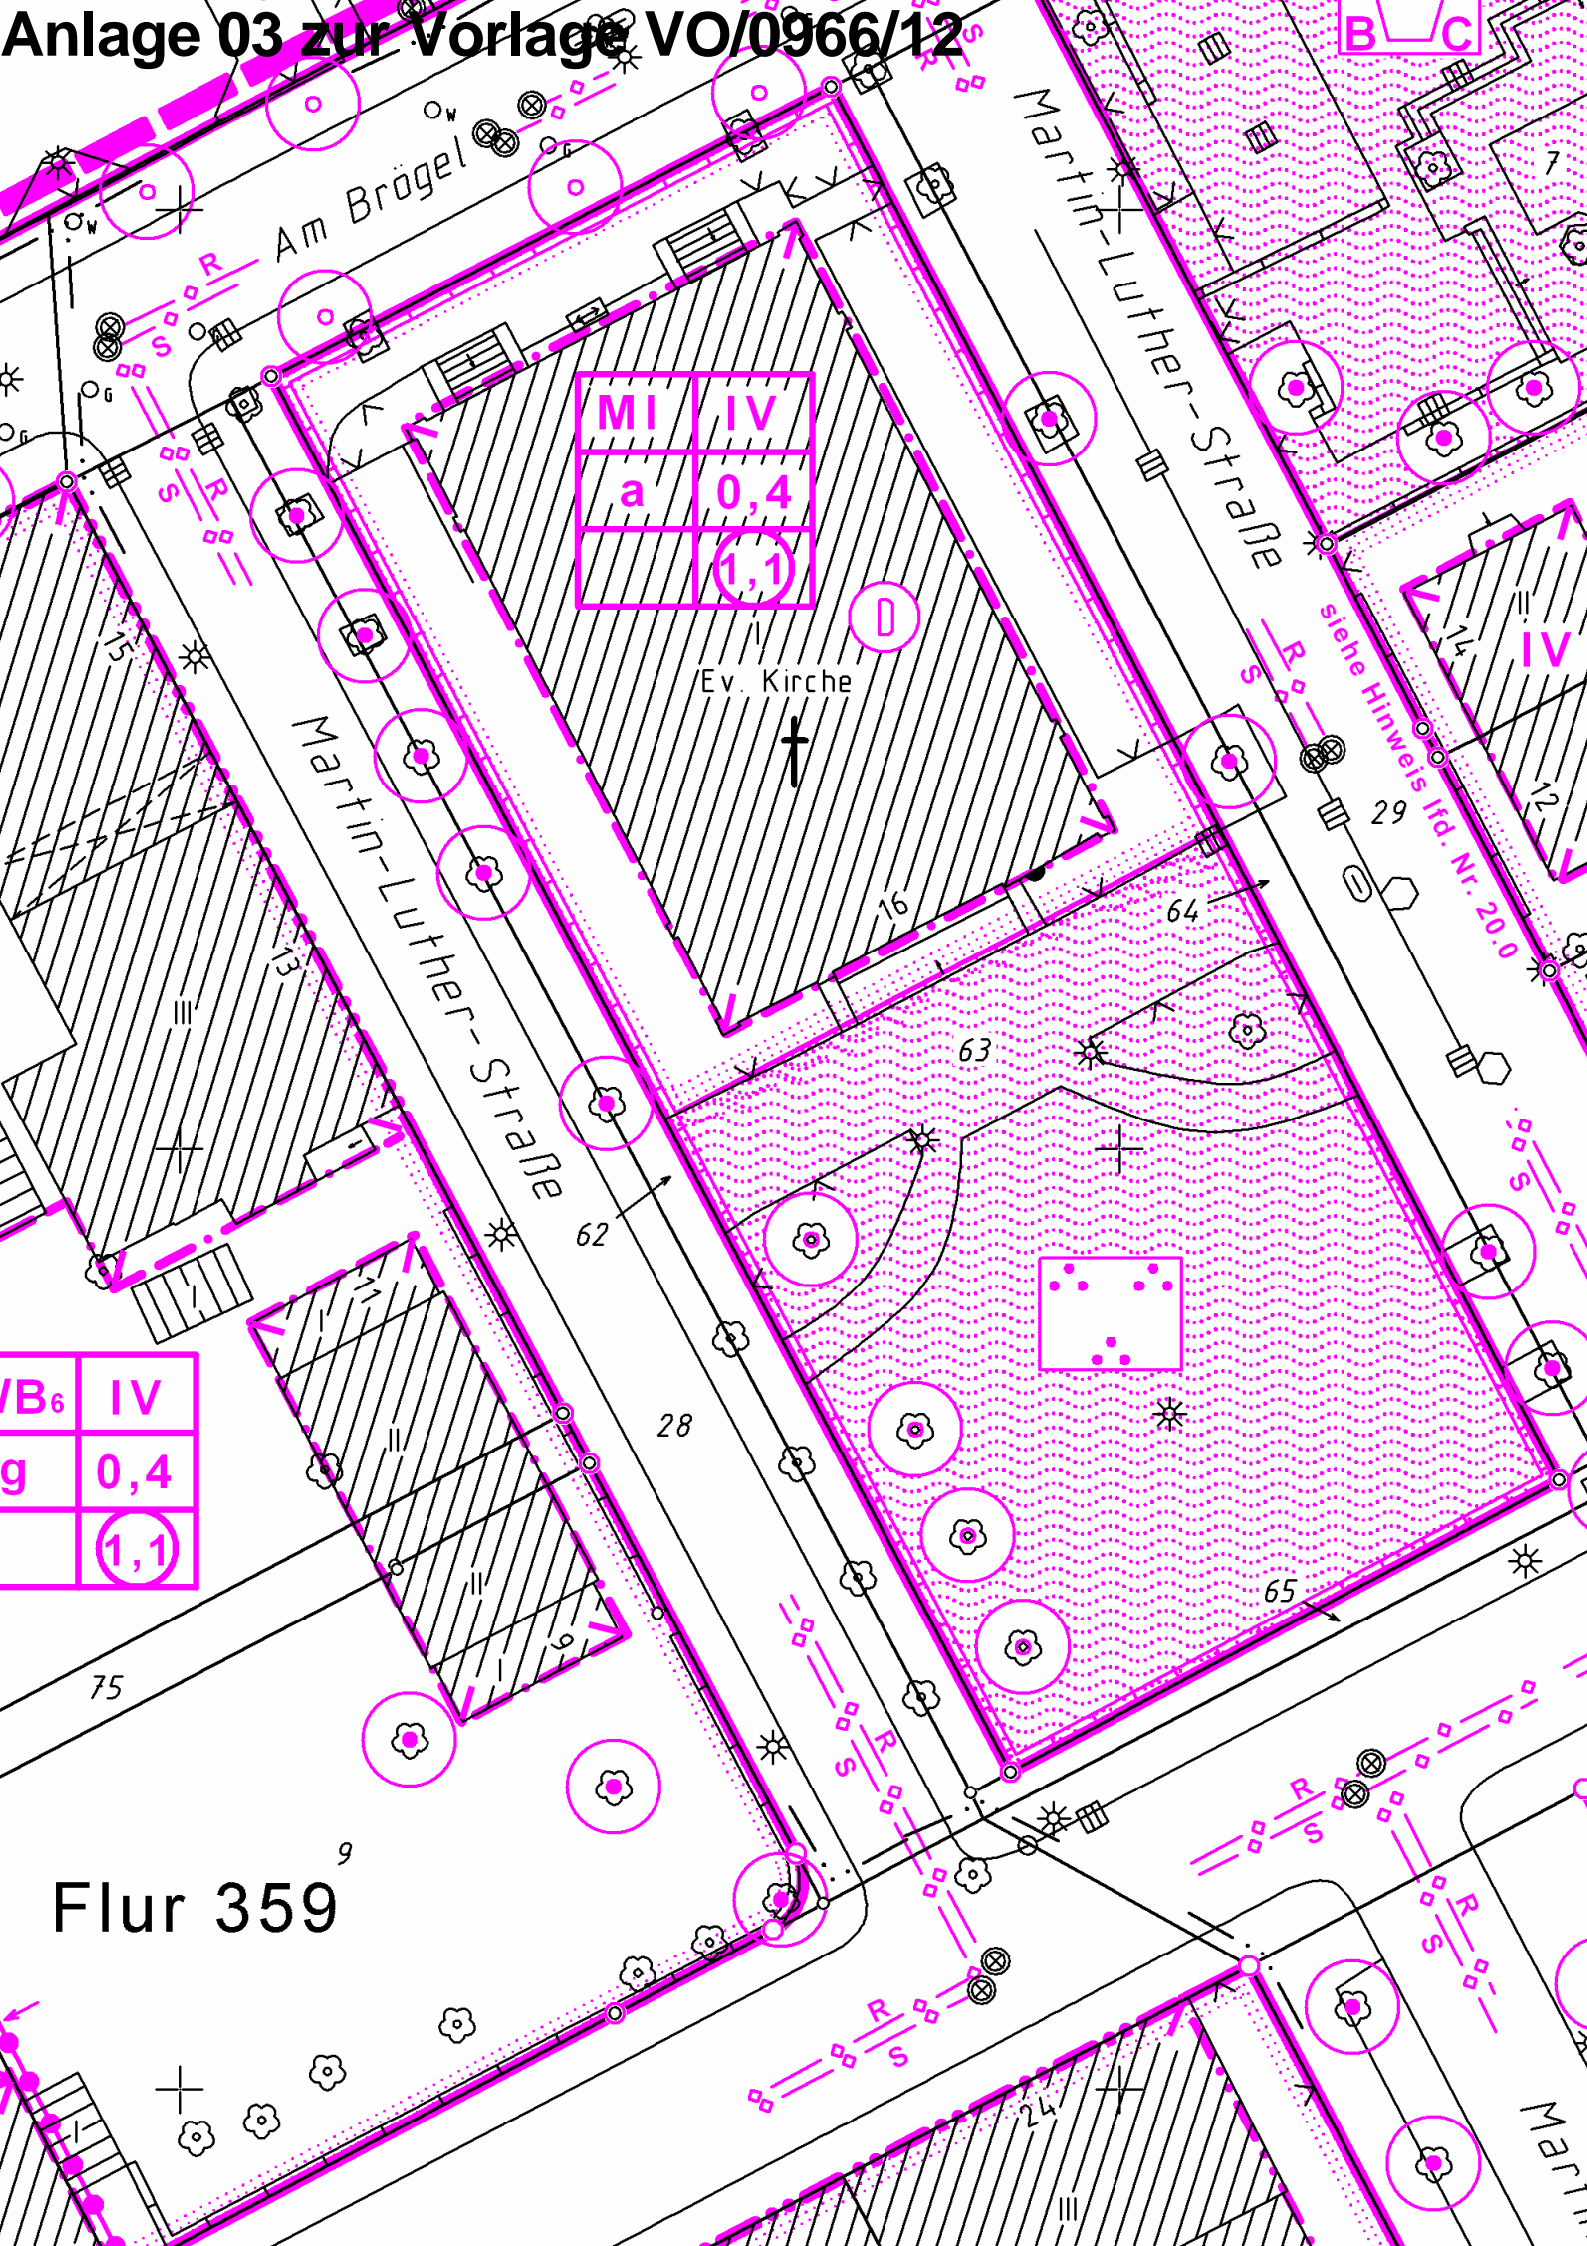

MI	IV
a	0,4
	(1,1)

/B ₆	IV
g	0,4
	(1,1)

Flur 359

B/C

siehe Hinweis lfd. Nr. 20.0